



**VELOCITY CONTROL TECHNOLOGY**

# TURBINE BYPASS SYSTEMS

**KOSO**

### Applications:


- HP to cold reheat
- HRH (Hot Reheat) to condenser, also known as:
  - IP/ LP bypass to condenser
  - LP bypass to condenser
- HP to condenser

**Purpose:** Turbine bypass systems increase the flexibility in operation of steam power plants. They assist in faster start-ups and shutdowns without incurring significant damage to critical and expensive components in the steam circuit due to thermal transients. In some boiler designs, turbine bypass systems are also used for safety function.


Major hardware components of turbine bypass systems are:

- Steam pressure-reducing valve
- Desuperheater
- Spraywater control valve
- Spraywater isolation valve
- Dump tube/sparger (only for bypass to condenser)
- Actuator

Performance of the turbine bypass system has a strong influence on plant heat rate and capacity, effective forced outage rate (EFOR) and long-term health of critical components such as boiler tubes, headers and steam turbines. Therefore, correct sizing and selection of all components in turbine bypass systems is essential for smooth operation of a steam plant.

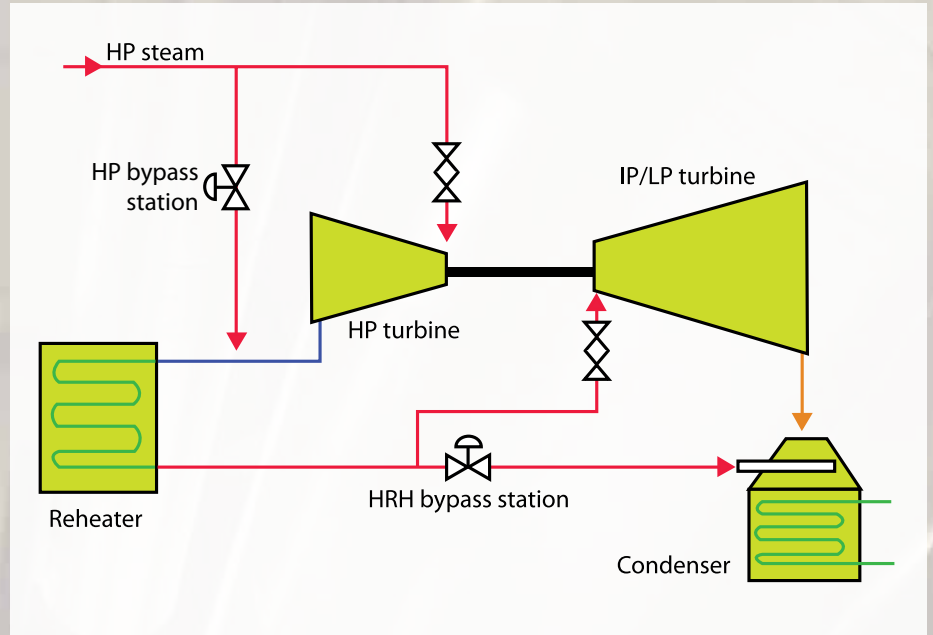

**Figure 1. Locations of turbine bypass systems.**

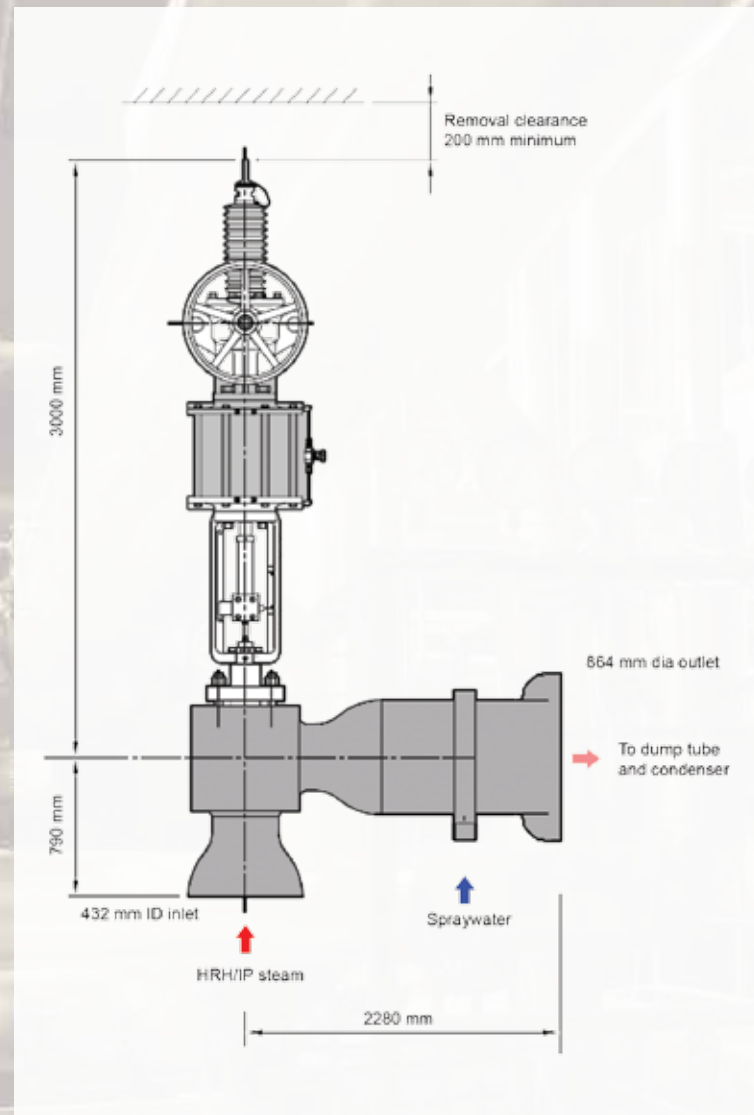

**Figure 2. Typical layout of an LP bypass system for a 500 MW supercritical unit**

Front cover: Custom engineered turbine bypass system for a 600 MW supercritical unit. One of two HP bypass systems and four LP bypass systems supplied.

**Table 1. Typical range of sizes and capacities of HP bypass to Cold Reheat systems for fossil plants**

Unit size (MW) x % bypass	Bypass flow	# of lines	Inlet/ outlet	Capacity (Cv) required
1000 MW x 30% (supercritical)	1000 MT/hr	1	14" / 20"	461
800 MW x 30% (supercritical)	800 MT/hr	1	12" / 18"	367
800 MW x 60% (supercritical)	1600 MT/hr	2	12" / 18"	367
600 MW x 30% (supercritical)	600 MT/hr	1	10" / 16"	278
600 MW x 60% (sub-critical)	1200 MT/hr	1	14" / 22"	845
500 MW x 60% (sub-critical)	1000 MT/hr	1	14" / 20"	740
250 MW x 60% (sub-critical)	500 MT/hr	1	12" / 18"	369
350 MW x 100% (sub-critical)	1150 MT/hr	1	14" / 22"	820

**Table 2. Typical range of sizes and capacities of HRH bypass to condenser systems for fossil plants**

Unit size (MW) x % bypass	Bypass flow	# of lines	Inlet/ outlet	Capacity (Cv) required
1000 MW x 30% (supercritical)	1160 MT/hr	2	16" / 24"	1894
800 MW x 30% (supercritical)	930 MT/hr	2	14" / 20"	1517
800 MW x 60% (supercritical)	1856 MT/hr	4	14" / 20"	1517
600 MW x 30% (supercritical)	695 MT/hr	2	14" / 18"	1136
600 MW x 60% (sub-critical)	1390 MT/hr	2	16" / 24"	2273
500 MW x 60% (sub-critical)	1160 MT/hr	2	16" / 24"	1894
250 MW x 60% (sub-critical)	580 MT/hr	2	12" / 16"	947
350 MW x 100% (sub-critical)	1350 MT/hr	1	24" / 36"	4419

**Table 3. Typical range of sizes and capacities of HP bypass to condenser systems (combined cycle plants)**

Steam turbine MW x % bypass	Bypass flow	# of valves	Inlet/ outlet	Capacity (Cv) required
150 MW x 100%	500 MT/hr	1	14" / 24"	563
90 MW x 100%	300 MT/hr	1	12" / 18"	338
60 MW x 100%	200 MT/hr	1	10" / 14"	221

**Table 4. Typical range of sizes and capacities of HRH bypass to condenser systems (combined cycle plants)**

Unit size (MW) x % bypass	Bypass flow	# of valves	Inlet/ outlet	Capacity (Cv) required
150 MW x 100%	580 MT/hr	2	12" / 16"	1100
90 MW x 100%	350 MT/hr	2	8" / 12"	660
60 MW x 100%	230 MT/hr	2	8" / 10"	440

Notes:

(1) The tables above only for the purposes of illustration of typical configurations, sizes, flows, Cv's etc. There will be differences with specific installations.

(2) The bypass systems referenced in the tables above refer to the steam PRV and the downstream desuperheater combined. The inlet/outlet sizes stated are the typical steam PRV inlet and DSH outlet sizes respectively. These can be fitted with reducers to match the pipe sizes for ease of installation.

Koso's 530D/540D bypass system provides a cost-effective solution in this severe duty application. It meets applicable codes in the power industry and is engineered taking a wealth of industry experience into account. The 530D/540D design meets the critical functional requirements of turbine bypass systems which are:

- **High reliability** – necessary to achieve high plant availability
- **Low vibration and noise** – for personnel and equipment safety
- **Fine control** – for smoothness of start-ups and shutdowns, as well as for long-term life of critical high-pressure, high-temperature components
- **Tight shutoff** – necessary to avoid penalty in heat rate and/or reduction in plant output; class V or MSS SP-61 shut-off is available upon request
- **Excellent, reliable desuperheating performance** – for long-term protection of the downstream equipment
- **Ease of maintenance** – no welded seat or cage

Turbine bypass systems are generally sized for a specific percent bypass, which depends on the end-users' intent and desire for functionality. Common practices for bypass capacity are 30 – 35%, 60 – 70% and 100% of the design flow. Each of these reflects differing intent of how the plant will be operated and/or the functionality desired in operation.

Koso's 530D/540D bypass systems are configured with pneumatic actuators; electro-hydraulic actuation is available upon request. Electric actuators are generally not used for this application unless slower response is permitted by the steam system design.

## Steam pressure reducing valve (PRV):

The steam pressure-reducing valve in turbine bypass systems is the primary mechanism of controlling the upstream pressure. It is available in different configurations – in the Koso system (a) in-line globe body (530D) or angle body (540D), and (b) flow-to-open or flow-to-close.

This results in four combinations. The final choice should be made based on the plant layout and users' preferences. Any of the combinations, when correctly designed, can meet the critical functional requirements for turbine bypass service.

Angle-body, with flow-to-open configuration, generally results in the most compact and lower weight package. This configuration is advantageous in several other respects including:

- Supporting requirements are less demanding
- Pre-warming requirements are simpler
- Valve and upstream pipe condensate drainage requirements are simpler
- Special treatment to eliminate noise at the outlet pipe is less likely

Typical flow conditions at full flow for modern turbine bypass systems are:

- HP bypass inlet - 180 bar A pressure for subcritical Units and 260 bar A for supercritical Units; temperature of 550°C
- IP/HRH bypass inlet - Pressure of 40 bar A and temperature of 560°C

For bypass to condenser, pressure at the outlet is determined by capacity of the dump tube or the device discharging into the condenser; typically, it ranges from 4 - 15 bar A at full flow condition. The trim in Koso steam PRV's is specially designed to keep noise and vibration within acceptable limits. The outlet cage dissipates the large high energy jet, which would otherwise form from the seat ring region into the outlet piping. This outlet cage is part of the quick change trim and can be easily inspected during regular maintenance. This is a major advantage over designs where similar baffles are welded in the body outlet region. Screwed in seat or cage should be avoided in this application.


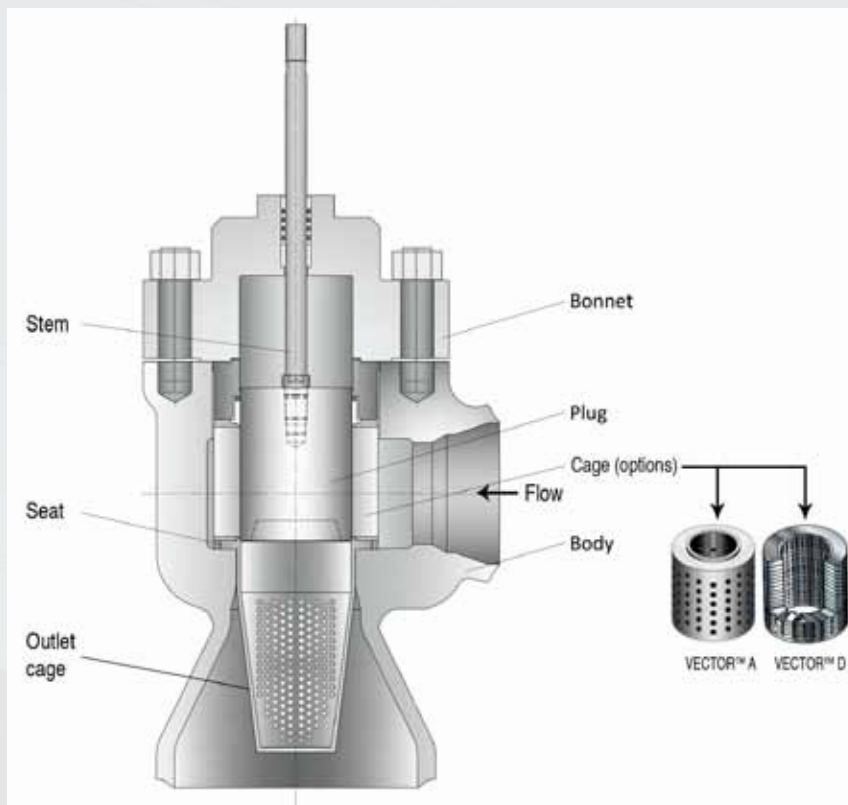


Figure 3. Cross-section of a steam pressure reducing valve with a VECTOR™ A trim.

Table 5. Typical materials of construction

	Design temperature	
	Up to 540 °C (1005 °F)	Above 540 °C (1005 °F) and up to 600 °C (1132 °F)
Body	A182 F22/A 217 WC9	A182 F91/ A217 C12A
Bonnet	A182 F22/A 217 WC9	A182 F91/ A217 C12A
Inlet cage	10CrMo910/A182 F22	X20CrMoV121
Plug	10CrMo910/A182 F22	X20CrMoV121
Stem	Inconel 718	Inconel 718
Seat	10CrMo910/A182 F22	X20CrMoV121
Outlet cage	10CrMo910/A182 F22	10CrMo910/A182 F22

Alternate materials are available to meet specific design requirements.

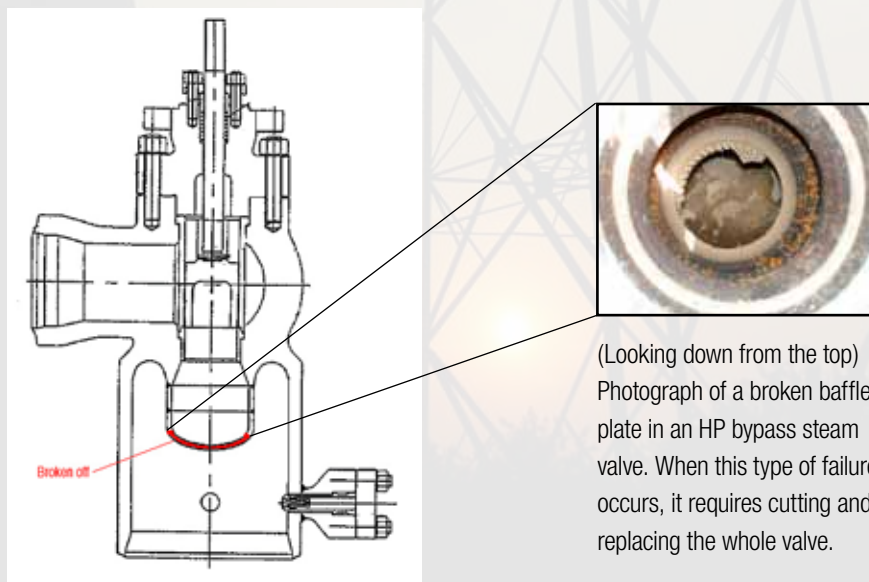

(Looking down from the top) Photograph of a broken baffle plate in an HP bypass steam valve. When this type of failure occurs, it requires cutting and replacing the whole valve.



Example of a spraywater valve.



Koso's VECTOR trim delivers reliable control, long life and freedom from cavitation, erosion, vibrations and noise problems.

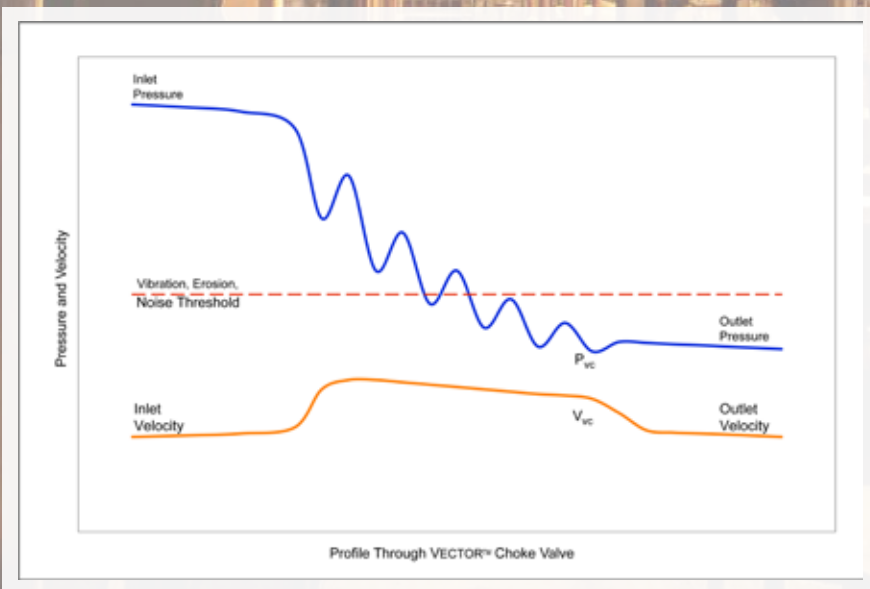


Figure 4. Velocity control valve eliminates cavitation.

**Spraywater control valve:** The function of the spray water valve is to regulate the correct amount of spraywater flow into the desuperheater. These are generally small valves, typically 2 to 4 inch in size and are available in angle-body or in-line globe body configurations. Direction of flow-to-close is preferred because this is a liquid service.

Critical functional requirements for the spraywater control valve are:

- High rangeability
- Quick response
- Good controllability
- Tight shutoff

Correct sizing of spraywater valves is critical to proper operation of turbine bypass systems. Excessive over-capacity in spraywater valves results in poor control at low flow rates.

Equal percentage or modified equal percentage characteristics is recommended to achieve good controllability. High thrust for seating is recommended to achieve repeatable tight shutoff in service.

**VECTOR™ velocity control trim:** The HP bypass spray application requires a velocity control trim like the type shown in Figure 4. Fluid kinetic energy along the flow path, within acceptable limits, which eliminates potential problems (cavitation, vibration, noise, premature erosion etc).

LP bypass spray and spraywater isolation usually are not severe services.

**Spraywater isolation valves:** These are recommended as protection for the desuperheater. They are intended to prevent cold spraywater from dripping on to, or coming into direct contact, with hot metal in the desuperheater, in case that the spraywater control valve develops a leak.

**Actuation:** Pneumatic actuators are common in modern turbine bypass systems. Actuators are sized to provide fine control and the high thrust that is required to ensure tight shutoff.

Special pneumatic control circuit, which is local to the control valve, controls action of the actuator according to the DCS signals; this includes fast open/close action and trip modes.

KOSO also offers electrohydraulic (EH) actuators for this service where requested.

Actuator type is one of the key descriptors of turbine bypass systems. Choice of actuation system is typically made by the end-user based on their prior experience and on the plant design. Until the mid-1980's, most of the turbine bypass valves featured "unbalanced trim" designs, which require very high actuator thrust. As a result, EH actuators were the only practical solution. There was no choice even when users experienced problems with their EH actuators, the typical problems being: high maintenance requirement, potential for fires, unreliability, limited tolerance for extreme environment (dust, humidity, heat, etc.).

Double-acting pneumatic actuators have been around for a very long time. They are simple in construction – that means potential for high reliability. Also, the devices that control these actuators had been well-known and readily available, in the industry. The evolution of modern turbine bypass designs with "balanced trim" designs resulted in thrust requirements that were within the capability of the pneumatic actuators. With that development, double-acting-pneumatic actuators found easy acceptance in the industry. It provided a viable option for end users who do not prefer EH systems.

Today, with the added benefits of easier maintenance and economy, pneumatic actuators have been accepted as a standard for turbine bypass systems in many power plant designs, although electro-hydraulic actuators continue to be used in some cases. A comparison of actuator options is shown in Table 6.

**Table 6. Comparison of actuator options (typical performance)**

Attribute	Pneumatic (Double-acting, piston)	Electro-hydraulic	Electric (fast)
Stroke time	< 2 seconds (< 1 second possible)	< 1 seconds	< 5 seconds
Positioning accuracy	< 2%	< 0.5%	< 2%
Step change response	< 1% overshoot	No overshoot	No overshoot
Reliability	Very high	Moderate to high	High
Maintenance requirement	Low	High	Moderate
Maintenance cost	Low	High	Moderate




Pneumatic piston actuator




Electro-hydraulic actuator



Custom engineered turbine bypass system for a supercritical plant with a low-volume, double-acting piston type pneumatic actuator

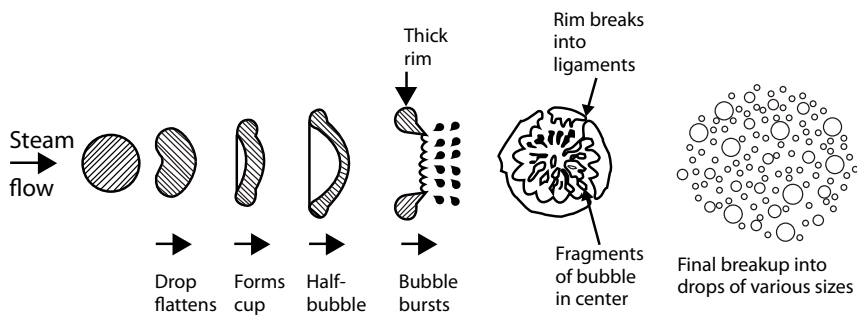

**Figure 5. Break-up of a water droplet by interaction with steam when Weber number ( $We$ ) is greater than 14.**  $We = \rho U^2 d / \sigma$  where  $\rho$  = steam density,  $U$  = relative velocity of steam,  $d$  = droplet diameter,  $\sigma$  = surface tension of water.

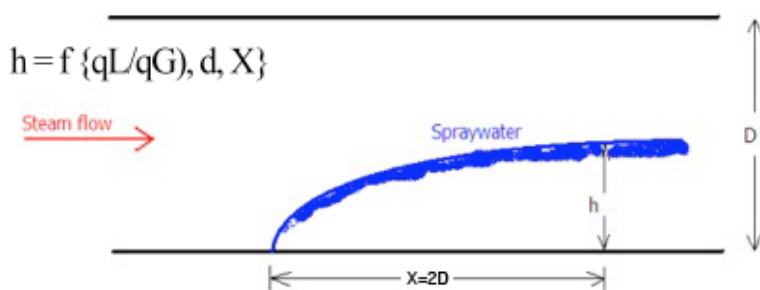

**Figure 6. Schematic of penetration of spraywater in a cross-flow of steam.**  $h = f \{qL/qG, d, X\}$   
 $h$  = spray penetration,  $qL$  = momentum of spraywater jet,  $qG$  = momentum of steam,  $d$  = jet diameter

**Desuperheater:** Desuperheating for turbine bypass applications is challenging because the amount of spraywater is huge. Typical requirement for LP turbine bypass service is 30 – 35% of the incoming steam flow. Even for a 30% bypass system in a 600 MW station, this means a spraywater flow rate of about 100 t/h, or the equivalent of five fire-hydrants, spraying in the pipe downstream of the LP bypass steam valve. Within the envelope of the pipe the desuperheater design has to ensure that:

- the cold spraywater does not impinge on the hot pipe wall – this is important for avoiding excessive thermal stresses and the resulting potential for cracking of pipes
- all the spraywater has to be evaporated within the short distance downstream that is available

For HP bypass to cold reheat systems, the situation is similar, even though the spraywater is about half that for the LP bypass systems.

The performance goals described above require fine atomization and proper dispersion of the spraywater. Large drops are not beneficial for the system. They tend to impinge on the side walls and/or fall out of the steam flow due to their high inertia. Even when they don't drop out of the steam flow, they require a long time to evaporate. Generation of small drops depends on the inherent nozzle injection characteristics (or primary atomization) as well as the energy of the steam flow into which the spray is injected (secondary atomization).

Atomization of liquid in a steam is governed primarily by Weber Number ( $We$ ), which is defined in Figure 5. This relationship shows the importance of the relative kinetic energy ( $1/2 \rho U^2$ ) of the steam in achieving fine atomization. It is the key principle used in the design of spray water nozzles as well as for the spray nozzle-steam system as a whole.

**Droplet size rule:** The droplet diameter needs to be less than 250  $\mu\text{m}$  under all operating conditions for optimum desuperheater performance.

Two other important considerations in desuperheater design is spray penetration and coverage. Spray penetration depends primarily on the momentum ratio of the injected spraywater and steam, initial size of the injection jet and downstream distance. See Figure 6.


**Spray penetration rule:** The spray penetration is controlled within 15 and 85% of the pipe diameter in a well-designed desuperheater.

Coverage is controlled by the number of spray nozzles used, their inherent characteristics, as well as their placement in the steam flow. This is important for thorough mixing of spraywater in steam, which is essential for efficient evaporation.


The selected desuperheater must meet all operating conditions for a system – not just the full-load or sizing condition. This requires recognition of the differing characteristics of each system. Secondary atomization of large drops from spray nozzles requires that the steam flow has sufficient energy. From the We relationship described earlier, 250  $\mu\text{m}$  droplet size corresponds to about 2 kPa (0.3 psi) of steam kinetic energy. This limits the performance capability of the desuperheater at low flow rates. This effect is more severe for HP bypass to cold reheat (CRH) than for turbine bypass to condenser.

A spray ring type desuperheater is best-suited for steam bypass to condenser service. It offers both simplicity and economy, while meeting all performance requirements. Kinetic energy of the steam at the outlet of the steam valve is sufficiently high at all operating conditions in bypass-to-condenser systems; as a result, all the injected spraywater is broken up into fine drops. Spraywater injection from a large number of jets is especially beneficial in achieving proper coverage across the steam pipes, which tend to be large in low pressure turbine bypass applications. (See Figure 7.)


Multi-nozzle ring desuperheaters have discrete spraywater nozzles distributed around the steam pipe circumference. This design is well-suited especially for HP bypass to CRH. Spraywater is injected through the variable-area, spring-loaded spray nozzles in this design. These specially designed spray nozzles ensure that a pre-determined  $\Delta P$ , which is sufficient for atomization, is available for spraywater injection- this ensures that the spraywater does not dribble at low spraywater flow requirements. (See Figure 8.)

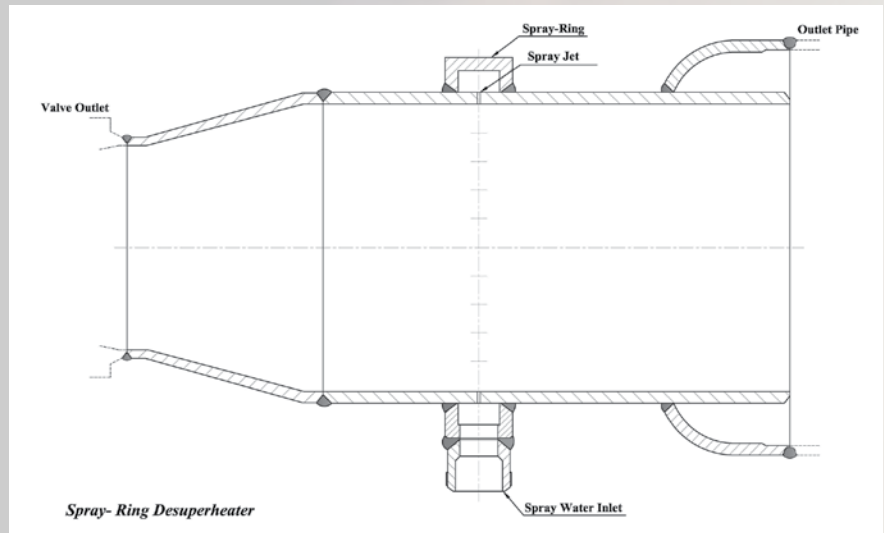

**Figure 7. Spray-ring desuperheater**

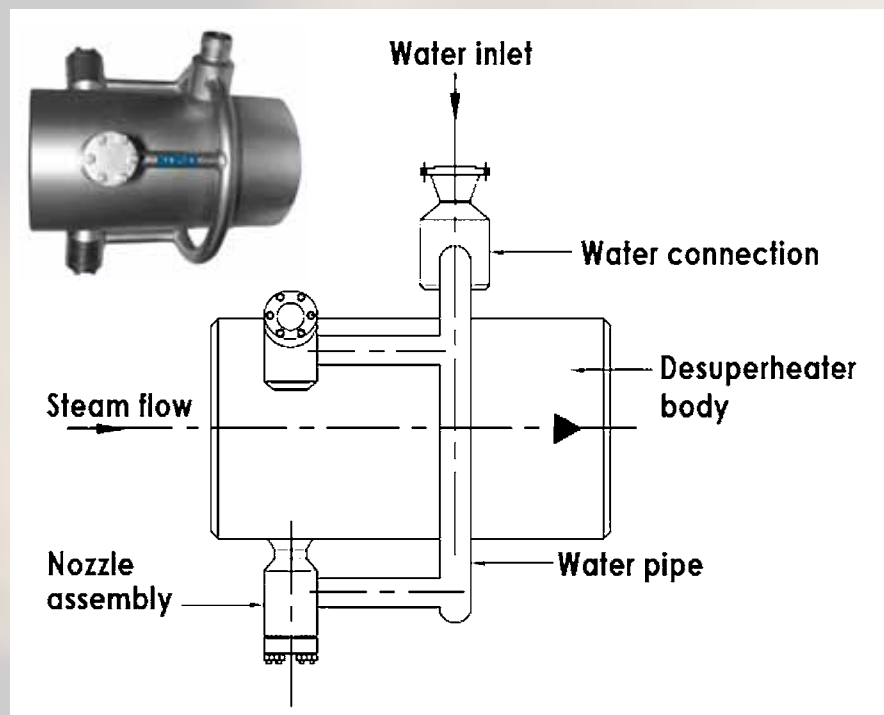

**Figure 8. Multi-Nozzle Ring Desuperheater schematic**

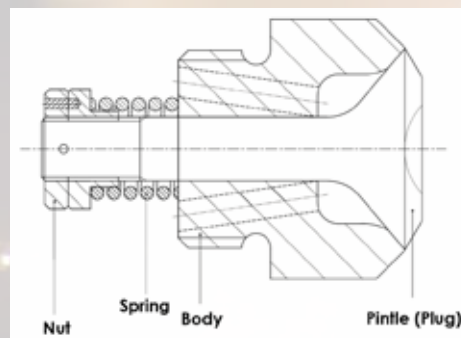

**Figure 9. Cross-section of a variable-area, spring-loaded spray nozzle**





### **Customization of turbine bypass systems:**

Customization is more of a rule than an exception in the power industry. Customization may be driven by the system operation or by special performance requirements. Common instances requiring customizations are pre-defined piping layout, noise requirements, system operation, etc. Special attention may be required for transitions between the steam valve and the desuperheater, and from the desuperheater to the outlet pipe, to ensure that excessive noise will not be a problem. Similar materials of construction are preferred at the pipe joint to avoid welding of dissimilar materials in the field.

A collaborative effort between the plant designers and turbine bypass system providers is essential in practically all situations. It results in cost-effective solutions that meet all the requirements and achieve optimum performance. Most importantly, it reduces the risk during the commissioning and for the long-term operation.



A custom VECTOR™ velocity control HP turbine bypass steam pressure-reducing valves with desuperheater for a power station in Eastern Europe featuring two inlets and fast-stroking electric actuators as requested by the customer.



**Related technical literature from KOSO (available upon request):**

1. Guidelines for Selection and Sizing of steam pressure-reducing valves in turbine bypass systems
2. Desuperheating for turbine bypass systems
3. Actuation for Turbine Bypass Systems - A Review of Requirements, Options and Recommendations
4. Installation Guidelines for Turbine Bypass Systems
5. Turbine Bypass Systems - FAQ's (Frequently Asked Questions)
6. Turbine Bypass Systems - Common Problems, Their Root Causes and Solutions



# KOSO

## **Headquarters**

Nihon KOSO Co., LTD.  
1-16-7, Nihombashi, Chuo-Ku  
Tokyo, Japan, 103-0027  
Tel: 81.3.5202.4100  
Fax: 81.3.5202.1511  
[www.koso.co.jp/en/](http://www.koso.co.jp/en/)

## **Worldwide locations**

China  
France  
India  
Russia  
Singapore  
South Korea  
United Arab Emirates  
United Kingdom  
United States of America